



Most Widely Accepted and Trusted

ICC-ES Report

ESR-1849

ICC-ES | (800) 423-6587 | (562) 699-0543 | www.icc-es.org

Reissued 01/2016
This report is subject to renewal 01/2018.

DIVISION: 06 00 00—WOOD, PLASTICS AND COMPOSITES
SECTION: 06 50 00—STRUCTURAL PLASTICS
SECTION: 06 63 00—PLASTIC RAILINGS

REPORT HOLDER:

RAILING DYNAMICS, INC.

135 STEELMANVILLE ROAD
EGG HARBOR TOWNSHIP, NEW JERSEY 08234

EVALUATION SUBJECT:

ENDURANCE® RAILING SYSTEM



Look for the trusted marks of Conformity!

“2014 Recipient of Prestigious Western States Seismic Policy Council (WSSPC) Award in Excellence”



ICC-ES Evaluation Reports are not to be construed as representing aesthetics or any other attributes not specifically addressed, nor are they to be construed as an endorsement of the subject of the report or a recommendation for its use. There is no warranty by ICC Evaluation Service, LLC, express or implied, as to any finding or other matter in this report, or as to any product covered by the report.



ICC-ES Evaluation Report

ESR-1849

Reissued January 2016

This report is subject to renewal January 2018.

www.icc-es.org | (800) 423-6587 | (562) 699-0543

A Subsidiary of the International Code Council®

**DIVISION: 06 00 00—WOOD, PLASTICS AND
COMPOSITES**
Section: 06 50 00—Structural Plastics
Section: 06 63 00—Plastic Railings
REPORT HOLDER:
RAILING DYNAMICS, INC.
 135 STEELMANVILLE ROAD
 EGG HARBOR TOWNSHIP, NEW JERSEY 08234
 (609) 601-1300
www.rdirail.com
EVALUATION SUBJECT:
ENDURANCE® RAILING SYSTEM

1.0 EVALUATION SCOPE

1.1 Compliance with the following codes:

- 2015, 2012, 2009 and 2006 *International Building Code*® (IBC)
- 2015, 2012, 2009 and 2006 *International Residential Code*® (IRC)
- 2013 *Abu Dhabi International Building Code* (ADIBC)[†]

[†]The ADIBC is based on the 2009 IBC. 2009 IBC code sections referenced in this report are the same sections in the ADIBC.

Properties evaluated:

- Structural
- Durability
- Surface-burning characteristics

1.2 Evaluation to the following green code(s) and/or standards:

- 2013 California Green Building Standards Code (CALGreen), Title 24, Part 11
- 2012 and 2008 ICC 700 National Green Building Standard™ (ICC 700-2012 and ICC 700-2008)

Attributes verified:

- See Section 3.1

2.0 USES

The Endurance® Railing System described in this report is limited to exterior use as guards for balconies, porches, and decks. The products described in this report are used in exterior applications in buildings of Type V-B (IBC) construction and other types of construction in applications where untreated wood is permitted by IBC Section 1406.3, or in buildings constructed in accordance with the IRC.

3.0 DESCRIPTION

3.1 General:

The Endurance® Railing System consists of 100 percent polyvinyl chloride (PVC) railing components and aluminum reinforcement members for the top and bottom hollow rails. The PVC railing components are white in color and are manufactured by an extrusion process in accordance with the approved quality control documentation.

The Endurance® Railing System is a guard consisting of top rails, bottom rails, balusters, nonstructural post sleeves and caps, rail-to-post connector brackets, an aluminum top reinforcing component, and bottom reinforcing component. The top rail insert is made from aluminum alloy 6105-T5; the bottom rail insert is made from aluminum alloy 6063-T6. The minimum yield and tensile strengths, and minimum thickness, of the aluminum inserts are specified in the approved quality control documentation. Each rail is attached to structural posts using PVC brackets with stainless steel post attachment screws. Turned or square PVC balusters are used as infill of the railing system.

The attributes of the railing system components have been verified as conforming to the requirements of (i) 2013 CALGreen Section A5.406.1.2 for reduced maintenance; (ii) ICC 700-2012 Sections 602.1.6 and 11.602.1.6 for termite-resistant materials and Sections 601.7, 11.601.7, and 12.1(A).601.7 for site-applied finishing materials; and (iii) ICC 700-2008 Section 602.8 for termite-resistant materials and Section 601.7 for site-applied finishing materials. Note that decisions on compliance for those areas rest with the user of this report. The user is advised of the project-specific provisions that may be contingent upon meeting specific conditions, and the verification of those conditions is outside the scope of this report. These codes or standards often provide supplemental information as guidance.

3.2 Guards:

The height of the railing assembly is 36 inches or 42 inches (914 or 1067 mm) above the walking surface. Each post is covered with a 4-inch-by-4-inch (102 mm by 102 mm) PVC sleeve. The top rail has a T-shape, is 3¹/₄ inches (82 mm) wide at the top and 1³/₄ inches (44.45 mm) wide at the bottom, has a total depth of 1³/₄ inches (44.45 mm); and a wall thickness of 0.085 inch (2.16 mm). The rectangular bottom rail is 1³/₄ inches (44.45 mm) wide at top and bottom, and has a depth of 3¹/₂ inches (88.9 mm) and a wall thickness of 0.105 inch (2.67 mm). Both top and bottom rails are available in 4-foot, 5-foot, 6-foot and 8-foot (1.22, 1.52, 1.83 and 2.44 m) lengths.

The balusters are hollow, blow-molded spindles as well as square extruded hollow pickets. The spindles are

1¹/₄ inches (31.75 mm) square at the top and bottom. The pickets are 1¹/₄ inches (31.75 mm) square, and have a wall thickness of 0.08 inch (2.03 mm). When the pickets are installed in the rails, there is a clear space of less than 4 inches (102 mm) between pickets.

The post sleeves are 4 inches (102 mm) square and have a wall thickness of 0.08 inch (2.03 mm). The optional bottom rail support mount is 1¹/₄ inches (31.75 mm) wide by 1³/₄ inches (44.45 mm) deep and has a wall thickness of 0.08 inch (2.03 mm). See Figure 2 for details of the top and bottom rail aluminum inserts. See Figure 3 for dimensioned profiles of the post sleeves, top and bottom rails, bottom rail support mount and balusters. The mounting brackets are made from molded plastic.

3.3 Durability:

When subjected to weathering, insect attack, and other decaying elements, the material used to manufacture the Endurance[®] Railing System is equivalent in durability to code-complying, preservative-treated or naturally durable lumber when used in locations described in Section 2.0. The Endurance[®] Railing System has been evaluated for structural performance when exposed to temperatures from -20°F (-29°C) to 125°F (52°C).

3.4 Surface-burning Characteristics:

When tested in accordance with ASTM E84, the Endurance[®] Railing System has a flame-spread index of no greater than 200.

4.0 DESIGN AND INSTALLATION

4.1 General:

The Endurance[®] Railing System must be installed in accordance with the manufacturer's published installation instructions, the approved construction documents and this report. The manufacturer's published installation instructions must be available at all times on the jobsite during installation.

4.2 Design:

The Endurance[®] Railing System is satisfactory to resist the loads specified in Section 1607.8.1 of the 2015 and 2012 IBC, Section 1607.7.1 of the 2009 and 2006 IBC and Table R301.5 of the IRC, when installed at a maximum 8-foot (2.44 m) edge-of-post to edge-of-post spacing. When the railing is supported on one or both ends by the supporting construction, the maximum distance must be measured from edge-of-post to edge-of-structure or from edge-of-structure to edge-of-structure. See Table 1.

4.3 Installation:

The top and bottom rails must be slid into their respective rail-to-post connector brackets. The top and bottom rail of the guard must be aluminum reinforced. The bottom aluminum reinforcing component must be installed with the top leg of the component facing the outside of the structure. The top and bottom rail-to-post connector brackets must be attached to wood vertical posts or to other supporting construction, such as an exterior wall.

The top rail-to-post connector bracket must be secured with two No. 10 by 2-inch (51 mm) stainless steel wood screws for connections to solid sawn lumber with a minimum specific gravity of 0.42 and two 1-inch (25.4 mm) stainless steel set screws to fasten top rail cover to the aluminum insert. The bottom rail-to-post connector bracket must be secured with four No. 10 by 2-inch (51 mm) stainless steel wood screws. The balusters must be installed by inserting each one into prerouted holes in both the top and bottom rails. There are two balusters in each

assembly that have crimped ends. These two balusters must be spaced evenly within the assembly. Vertical supports (posts) for the Endurance[®] Railing System are outside the scope of this report and must be designed to resist horizontal and vertical loads on the guard as specified in the applicable code. See Figure 1 for top rail assembly detail.

5.0 CONDITIONS OF USE

The Endurance[®] Railing System described in this report complies with, or is a suitable alternative to what is specified in, those codes listed in Section 1.0 of this report, subject to the following conditions:

- 5.1 This product is limited to exterior use as a guardrail system for balconies, porches and decks in buildings of Type V-B (IBC) construction and other types of construction in applications where untreated wood is permitted by IBC Section 1406.3, or in buildings constructed in accordance with the IRC.
- 5.2 Installation must comply with this report, the manufacturer's published installation instructions and the applicable code. When the manufacturer's published installation instructions differ from this report, this report governs.
- 5.3 Only those fasteners and fastener configurations described in this report have been evaluated for the installation of the Endurance[®] Railing System. The compatibility of the fasteners with the supporting construction, including chemically treated wood, is outside the scope of this report.
- 5.4 The Endurance[®] Railing System must be directly fastened to supporting construction having adequate strength and stiffness. Where required by the code official, engineering calculations and construction documents consistent with this report must be submitted for approval. The calculations must verify that the supporting construction complies with the applicable building code requirements and is adequate to resist the loads imparted upon it from the products and systems discussed in this report. The documents must contain details of the attachment to the supporting structure consistent with the requirements of this report. The documents must be prepared by a registered design professional where required by the statutes of the jurisdiction in which the project is to be constructed.
- 5.5 The use of wood posts, with or without post sleeves, is outside the scope of this report.
- 5.6 The use of a corner rail connection that is connected to a rail post is outside the scope of this report.
- 5.7 The Endurance[®] Railing System is produced in Millville, New Jersey, under a quality control program with inspections by ICC-ES.

6.0 EVIDENCE SUBMITTED

Data in accordance with the ICC-ES Acceptance Criteria for Deck Board Span Ratings and Guardrail Systems (Guards and Handrails) (AC174), dated January 2012.

7.0 IDENTIFICATION

The Endurance[®] Railing System described in this report is identified by a stamp, on each individual piece or on the packaging, bearing the report holder's name (Railing Dynamics, Inc.), the product name (Endurance[®] Railing System), the allowable span and the ICC-ES evaluation report number (ESR-1849).

TABLE 1—MAXIMUM GUARDRAIL SYSTEM SPANS¹

PRODUCT NAME/COMPONENT	APPLICABLE BUILDING CODE ^{2,5}		MAXIMUM SPAN ^{3,4} (ft-in)
	IBC	IRC	
Endurance [®] Railing System with Square Balusters	Yes	Yes	8-0
Endurance [®] Railing System with Turned Balusters	Yes	Yes	8-0

For SI: 1 inch = 25.4 mm; 1 ft = 305 mm.

¹The ability of the supporting construction to resist the reactionary loads must be justified to the satisfaction of the code official.

²Indicates compliance with the respective building codes.

³Maximum span is measured from edge-of-post to edge-of-post, edge-of-post to edge-of-structure or edge-of-structure to edge-of-structure.

⁴Maximum allowable span has been adjusted for durability. No further increases are permitted.

⁵The minimum height of the top rail is 42 inches for the IBC (Section 1015 in the 2015 IBC and Section 1013 in the 2012, 2009 and 2006 IBC) and 36 inches for the IRC (Section R312).

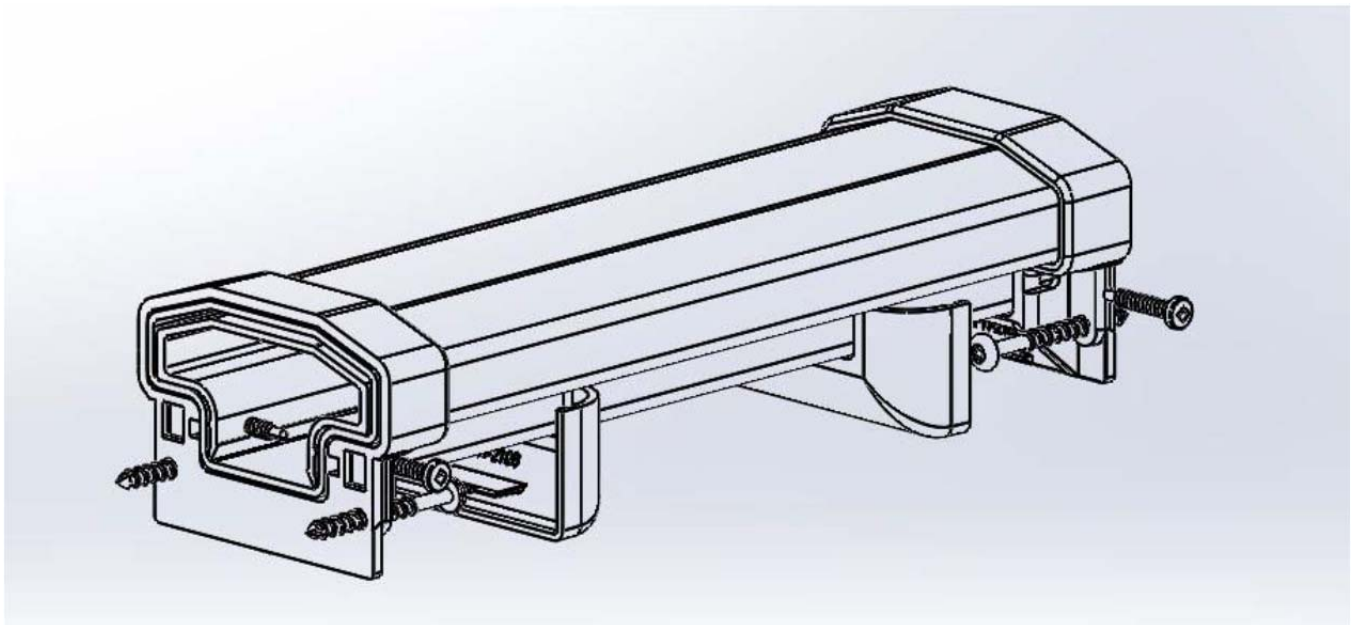


FIGURE 1—TOP RAIL MOUNTING ASSEMBLY

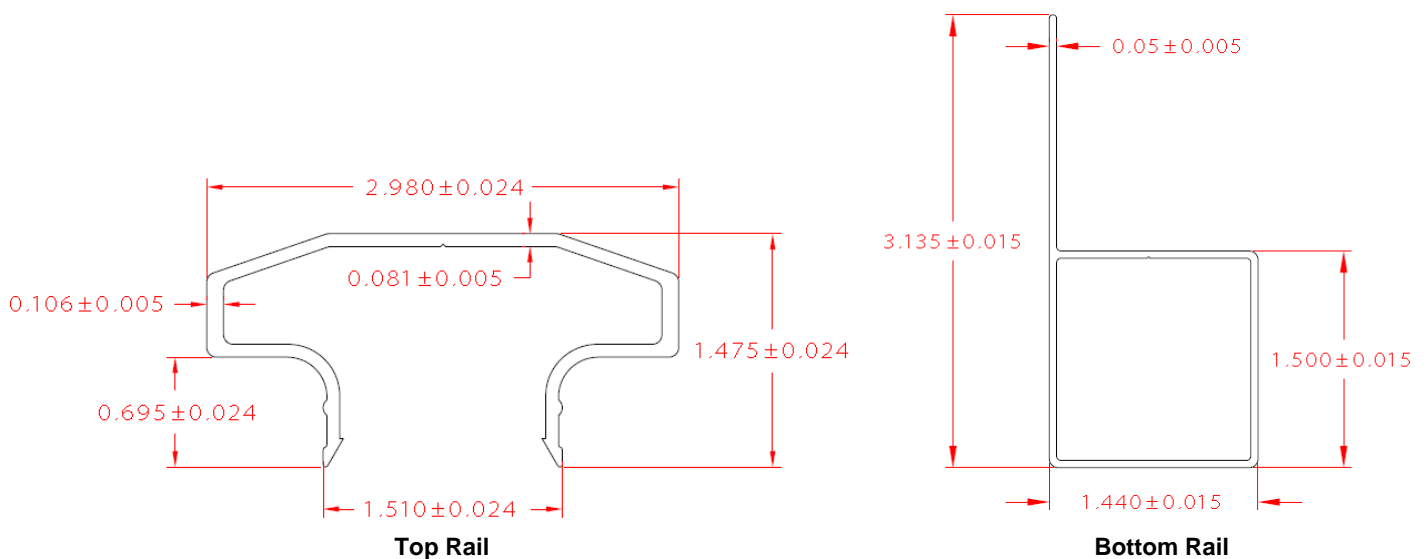


FIGURE 2—ALUMINUM TOP AND BOTTOM RAIL INSERTS (dimensions in inches)

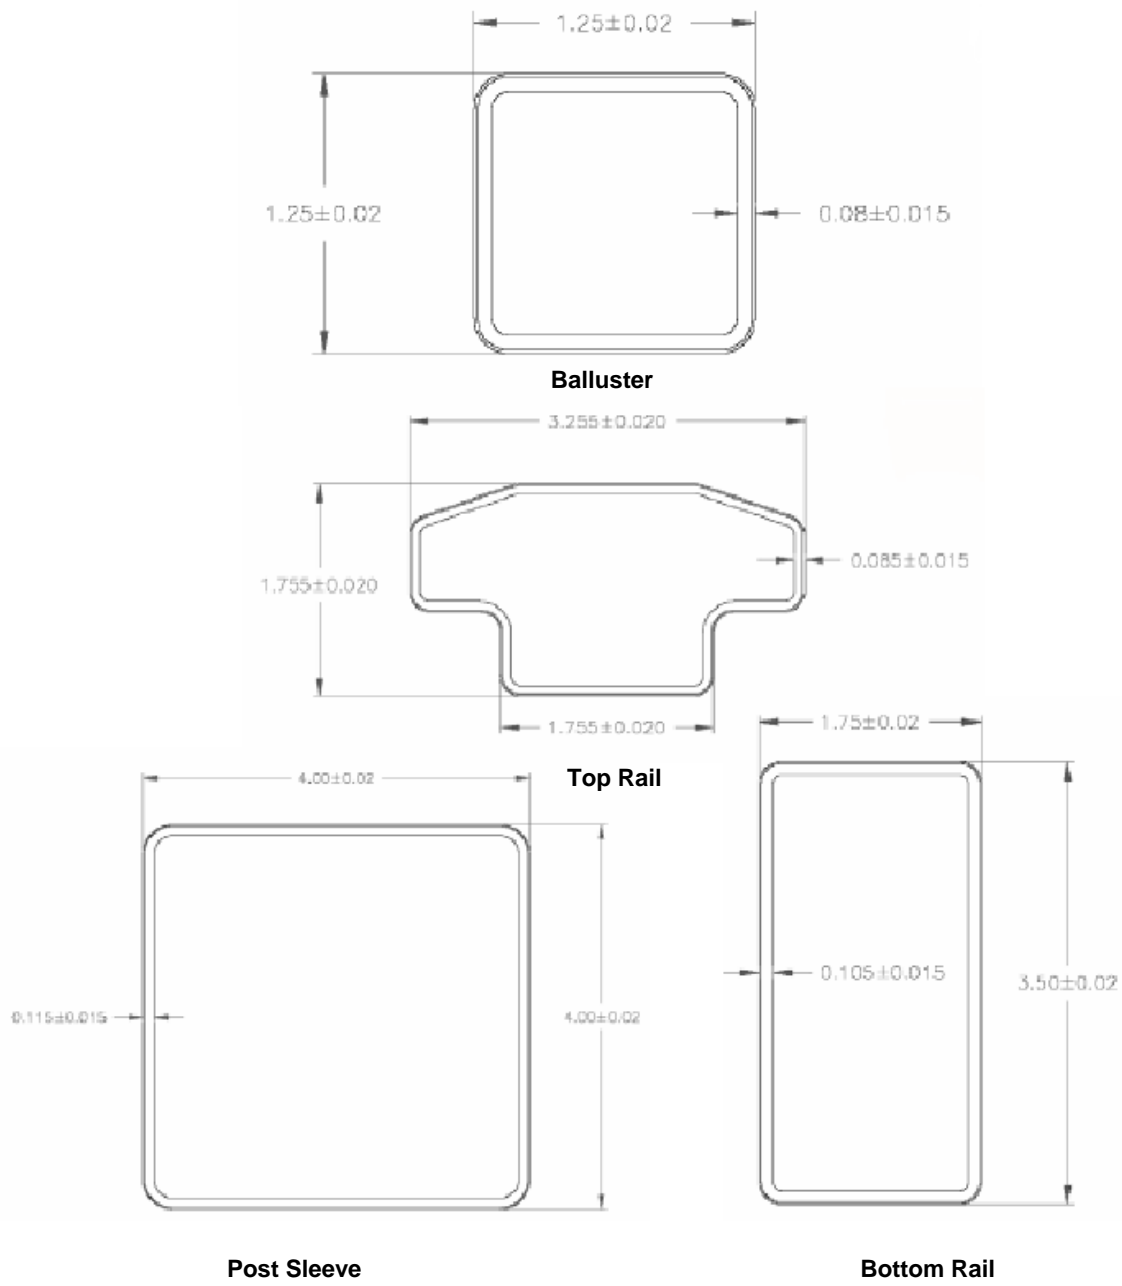


FIGURE 3—PLASTIC PROFILES OF TOP AND BOTTOM RAIL, BOTTOM RAIL SUPPORT MOUNT, POST SLEEVE AND BALUSTER (dimensions in inches)