

ICC-ES Evaluation Report

ESR-2767


Reissued December 2024

This report also contains:



- CA Supplement

Subject to renewal December 2025

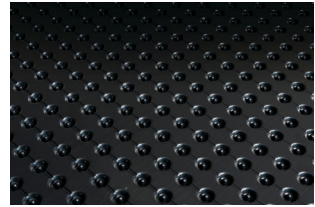ICC-ES Evaluation Reports are not to be construed as representing aesthetics or any other attributes not specifically addressed, nor are they to be construed as an endorsement of the subject of the report or a recommendation for its use. There is no warranty by ICC Evaluation Service, LLC, express or implied, as to any finding or other matter in this report, or as to any product covered by the report.



Copyright © 2024 ICC Evaluation Service, LLC. All rights reserved.

<p>DIVISION: 07 00 00 — THERMAL AND MOISTURE PROTECTION</p> <p>Section: 07 11 00 — Dampproofing</p> <p>Section: 07 13 00 — Sheet Waterproofing</p>	<p>REPORT HOLDER: ARMTEC</p> 	<p>EVALUATION SUBJECT: PLATON FOUNDATION MEMBRANE</p>	
---	---	--	---

1.0 EVALUATION SCOPE

1.1 Compliance with the following codes:

- 2018, 2015, 2012, and 2009 [International Building Code® \(IBC\)](#)
- 2018, 2015, 2012, and 2009 [International Residential Code® \(IRC\)](#)

Property evaluated:

- Foundation dampproofing
- Wall waterproofing (IRC only)

1.2 Evaluation to the following standards:

- 2020, 2015, 2012 and 2008 [ICC 700 National Green Building Standard™](#) (ICC 700-2020, ICC 700-2015, ICC 700-2012 and ICC 700-2008)

Attributes verified:

See Section 2.0

2.0 USES

Platon foundation membrane is a below-grade, exterior-wall, sheet membrane system that performs as a foundation wall dampproofing material on cast-in-place concrete, concrete masonry, insulated concrete forms (ICFs) or treated wood foundations. In jurisdictions adopting the IRC, the membrane may be considered as a foundation wall waterproofing material for use in applications of low hydrostatic pressure (i.e., locations with perched watertables).

The attributes of Platon foundation membrane have been verified as conforming to the provisions of (i) ICC 700-2020 Sections 602.1.2 and 11.601.2.1.2; (ii) ICC 700-2015 and ICC 700-2012 Section 602.1.2; and (iii) ICC 700-2008 Section 602.11 for foundation waterproofing. Note that decisions on compliance for those areas rest with the user of this report. The user is advised of the project-specific provisions that may be contingent on upon meeting specific conditions, and the verification of those conditions is outside the scope of this report. These codes or standards often provide supplemental information as guidance.

3.0 DESCRIPTION

Platon foundation membrane is a carbon-compounded high-density polyethylene (HDPE) sheet membrane, manufactured with a dimpled surface on one side to provide a continuous air gap between the foundation wall and the adjacent soil. The membrane keeps ground moisture (rain water) from coming into direct contact with the foundation wall. The air gap allows moisture and water vapor from indoors to condensate against the membrane, flow down to the footing and be drained away from the building. The membrane is 0.02 inch [(0.6 mm) 24 mils] thick and available in rolls 65.6 feet (20 m) in length and up to 10 feet (3 m) in width. The membrane weighs 1.77 oz/ft² (540 g/m²). The surface pattern features double cone dimples 0.24 inch (6 mm) high and 1.18 inches (30 mm) on center. See [Figure 1](#). The dampproofing system includes membrane material, molding, fasteners, speedclips, speedstrips and sealants.

4.0 DESIGN AND INSTALLATION

The Platon foundation membrane must be installed in accordance with the manufacturer's published installation instructions, this report, and the applicable code. The manufacturer's published installation instructions and this report must be strictly adhered to, and a copy of the instructions must be available at all times on the jobsite during installation.

The membrane is installed, with the dimpled side of the sheet facing the foundation, from the finished grade to the top of the footing. See [Figure 2](#). The membrane is mechanically fastened to concrete walls along the undimpled top edge with Armtec-supplied Speedclips fastened with 1¹/₄-inch-long (32 mm) concrete nails at 12 inches (305 mm) on center. Speedclips must mesh two rows of dimples. The smooth tab of the membrane must be pressed against the foundation wall into a continuous bead of sealant and held by Speedclips. Platon molding may be nailed along the smooth tab with 1¹/₄-inch-long (32 mm) concrete nails centered between Speedclips in lieu of sealant.

The membrane may also be secured with Armtec-supplied 4-foot-long (1219 mm) Platon Speedstrips fastened with 1¹/₄-inch-long (32 mm) concrete nails at 8 inches (203 mm) on center in lieu of Speedclips and sealant or Speedstrips and molding. Speedstrips must mesh the top row and half of the dimples. A 1/4-inch space (6.4 mm) must be allowed between Speedstrips.

The vertical joints of the membrane must be overlapped 20 inches (50 cm) and dimples interlocked. Horizontal joints must be overlapped 6 inches (152 mm), upper course over lower course.

Manufacturer supplied Platon molding must be used to cap locations where the membrane is cut and soil could enter the air gap.

For insulated concrete forms and wood foundations, 1¹/₂-inch-long (38 mm) screws must be used in lieu of concrete nails through either the Speedclip or Speedstrip fastening plate. The ICFs must have crossies at 6 inches (152 mm) or 8 inches (203 mm) on center. The fasteners must be driven into the flanges of the crossies. The smooth tab must be pressed against a continuous bead of foam compatible sealant when using Speedclips.

5.0 CONDITIONS OF USE

The Platon foundation membrane described in this report complies with, or is a suitable alternative to what is specified in, those codes listed in Section 1.0 of this report, subject to the following conditions:

- 5.1** Platon foundation membrane must be installed in accordance with the manufacturer's published installation instructions, this evaluation report, and the applicable code. This report governs if there are any conflicts between the manufacturer's published installation instructions and this report.
- 5.2** The backfill of the foundation must be clean soil free of rocks or other deleterious materials so as not to damage the foundation or the membrane system. For jurisdictions adopting the IBC, the backfill must be placed in lifts and compacted. The design and construction of the foundation must be in accordance with the applicable code.
- 5.3** Platon foundation membrane must be stored inside prior to installation.
- 5.4** The foundation wall protected with the membrane must be backfilled as soon as possible to protect the material from prolonged exposure to ultraviolet radiation.
- 5.5** Use of Platon foundation membrane is limited to foundation walls up to 12 feet (3.7 m) in height.

- 5.6 Use of the membrane under the IBC as waterproofing is outside the scope of this report.
- 5.7 The design and installation of the foundation drainage system is outside the scope of this report. A foundation drainage system must be provided in accordance with IBC Section 1807.4 or IRC Section R405, as applicable.
- 5.8 The use of the “Flood Boot” described in the manufacturer’s installation instructions as a special waterproofing arrangement is outside the scope of this report.

6.0 EVIDENCE SUBMITTED

Data in accordance with [ICC-ES Acceptance Criteria for Rigid, Polyethylene, Below-grade, Dampproofing and Wall Waterproofing Material \(AC114\)](#), dated March 2012 (editorially revised April 2019).

7.0 IDENTIFICATION

- 7.1 The Platon foundation membrane and manufacturer-supplied components described in this report must be identified by a stamp on the packaging that bears the manufacturer’s name (Armtec) and address, the product name, and the evaluation report number (ESR-2767).
- 7.2 The report holder’s contact information is the following:

ARMTEC
301 ROKEBY SIDEROAD
TILLSONBURG, ONTARIO N4G 4G7
CANADA
(519) 942-2643
www.armtec.com

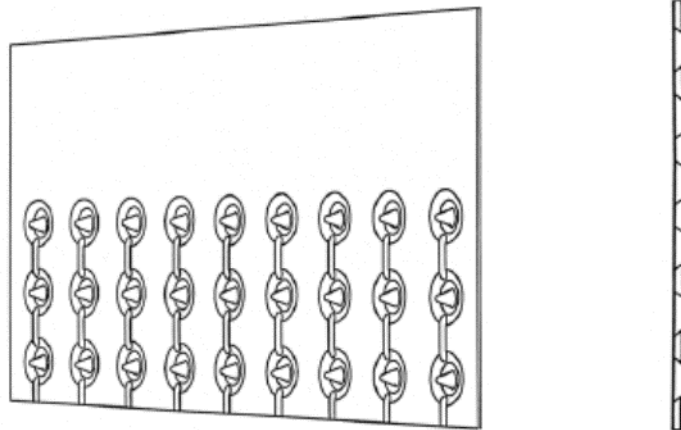


FIGURE 1—PLATON FOUNDATION MEMBRANE

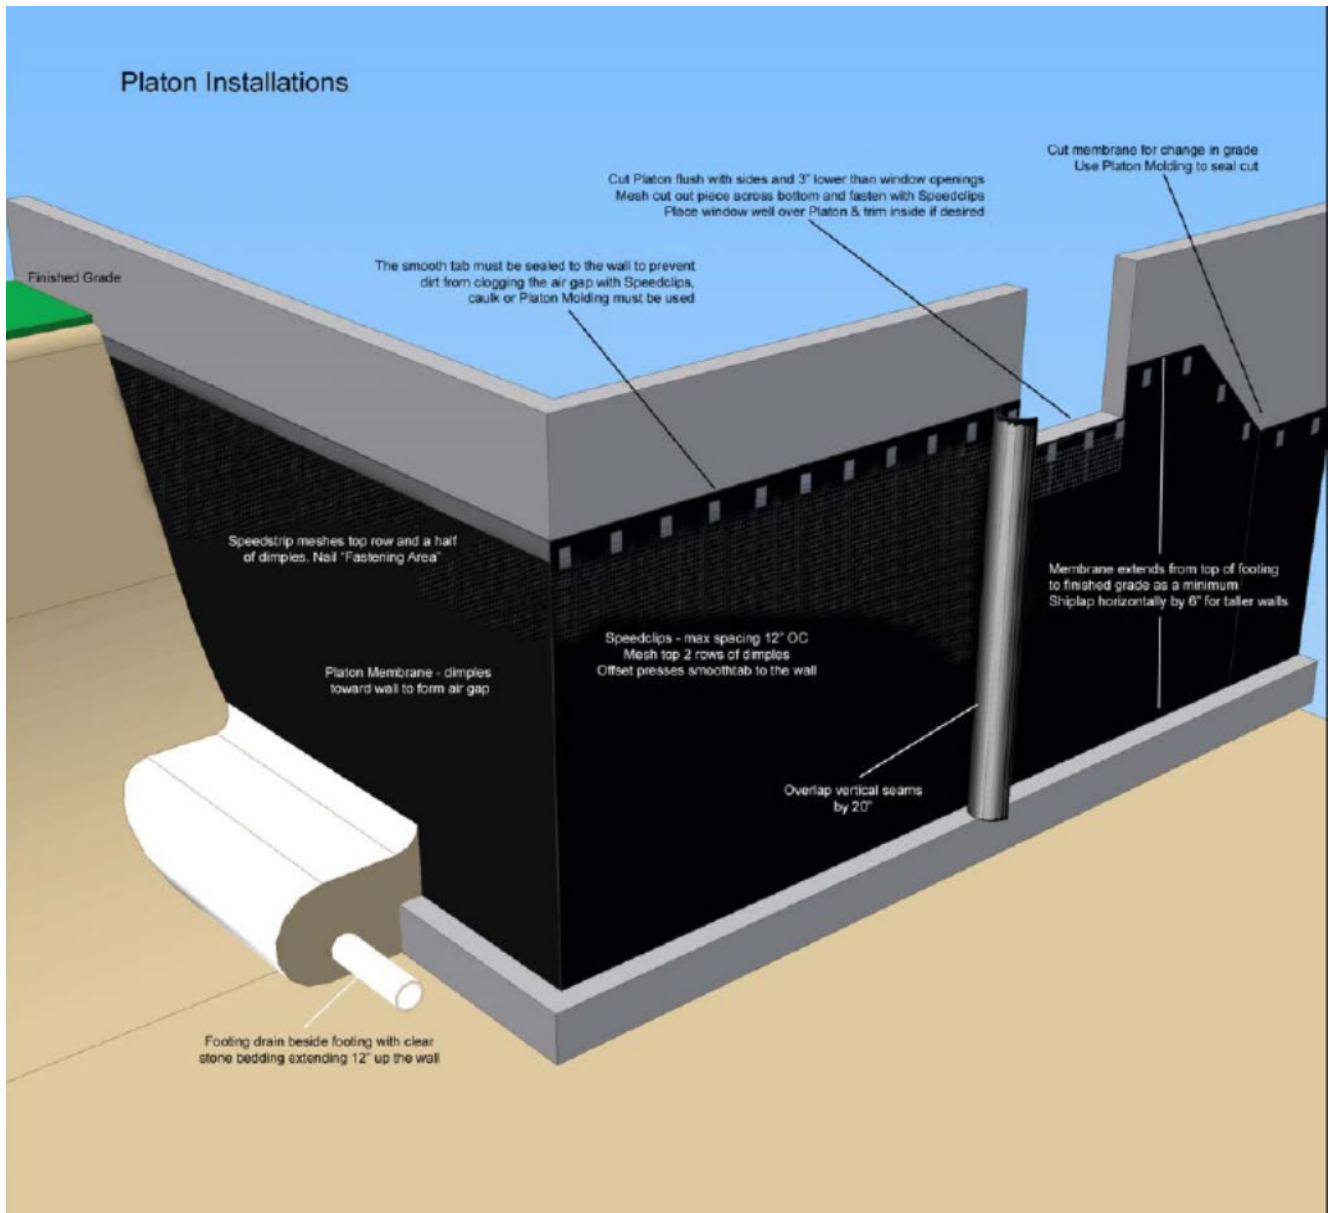


FIGURE 2—INSTALLATION DETAILS

DIVISION: 07 00 00—THERMAL AND MOISTURE PROTECTION**Section: 07 11 00—Dampproofing****Section: 07 13 00—Sheet Waterproofing****REPORT HOLDER:**

ARMTEC

EVALUATION SUBJECT:

PLATON FOUNDATION MEMBRANE

1.0 REPORT PURPOSE AND SCOPE**Purpose:**

The purpose of this evaluation report supplement is to indicate that the Platon Foundation Membrane, described in ICC-ES evaluation report ESR-2767, has also been evaluated for compliance with the codes noted below.

Applicable code edition(s):

- 2019 *California Building Code* (CBC)

For evaluation of applicable chapters adopted by the California Office of Statewide Health Planning and Development (OSHPD) and Division of State Architect (DSA), see Sections 2.1.1 and 2.1.2 below.

- 2019 *California Residential Code* (CRC)

2.0 CONCLUSIONS**2.1 CBC:**

The Platon Foundation Membrane, described in Sections 2.0 through 7.0 of the evaluation report ESR-2767, complies with CBC Chapter 18, provided the design and installation are in accordance with the 2018 *International Building Code*® (IBC), as applicable provisions noted in the evaluation report and the additional requirements of 2019 CBC Chapter 18, as applicable.

2.1.1 OSHPD: The applicable OSHPD Sections of the CBC are beyond the scope of this supplement.

2.1.2 DSA: The applicable DSA Sections of the CBC are beyond the scope of this supplement.

2.2 CRC:

The Platon Foundation Membrane, described in Sections 2.0 through 7.0 of the evaluation report ESR-2767, complies with 2019 CRC Chapter 4, provided the design and installation are in accordance with the 2018 *International Residential Code*® (IRC) provisions noted in the evaluation report.

This supplement expires concurrently with the evaluation report, reissued December 2024.